



# Standard Detail & Specifications

## Culvert Inlet Protection

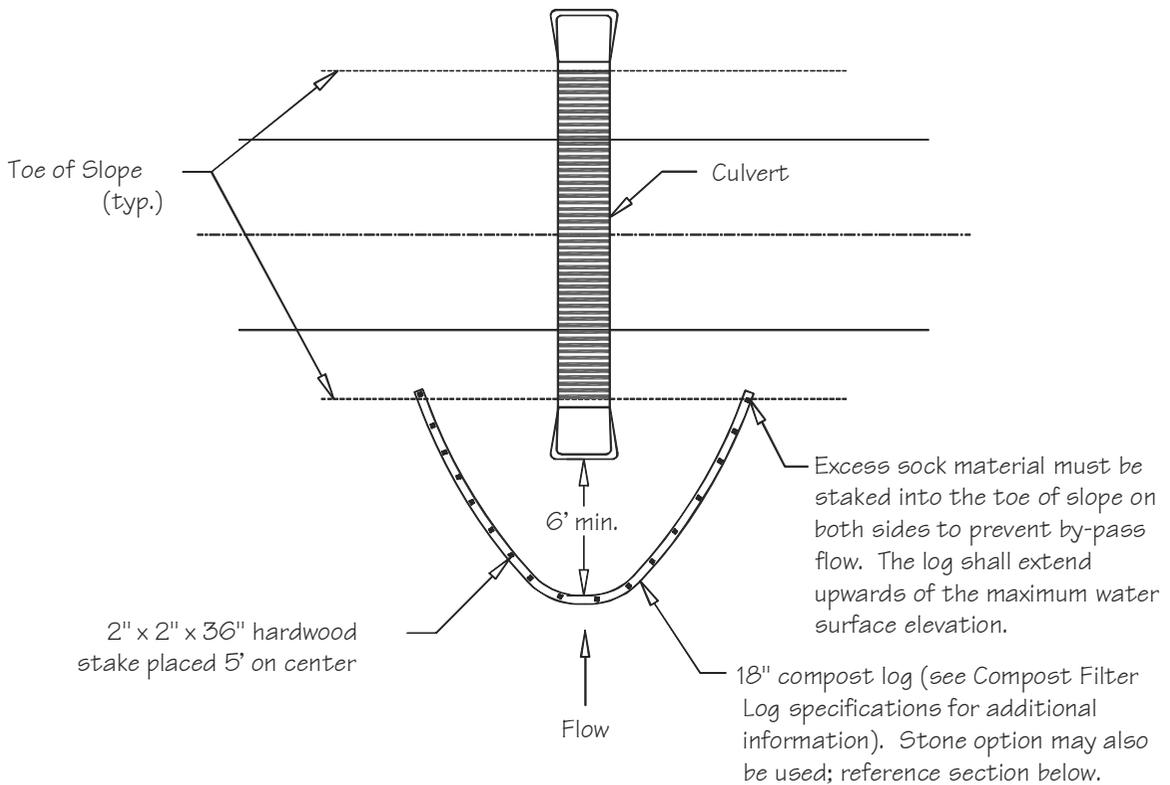

Plan View - Compost Log Option

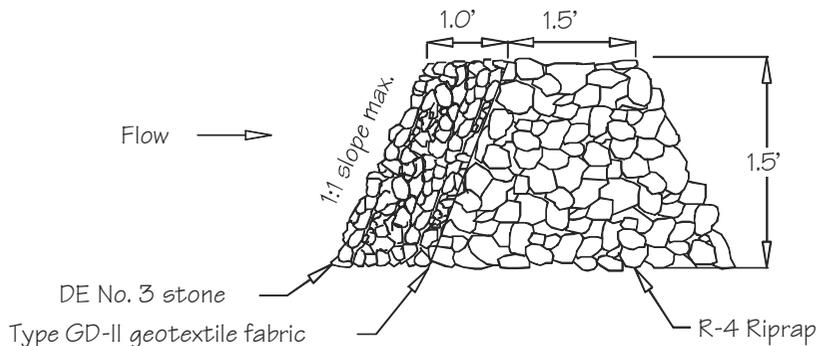

Section View - Stone Option

Source:

Adapted from  
VA ESC Handbook  
& Filtrexx™ International

Symbol:




Detail No.

**DE-ESC-3.1.6**

Sheet 1 of 2

Effective FEB 2019



# Standard Detail & Specifications Culvert Inlet Protection

## Construction Notes

1. Compost logs shall be designed and installed in accordance with the Standard Detail and Specifications for Compost Logs (DE-ES-3.1.7).
2. If compost logs can not be installed properly or flow conditions exceed the design capabilities of the compost logs, the stone option shall be employed. Additional filtration may be provided by using a Type GD-II geotextile incorporated into the design as an option.
3. Placement of the compost log or stone barrier should be in a "horseshoe" shape and provide a minimum of 6 feet of clearance from the culvert inlet.

## Materials

1. Stakes: 2" x 2" x 36" hardwood.
2. Compost media : See requirements in Standard Detail and Specifications for Compost Logs (DE-ES-3.1.7).
3. Filter sock: See requirements in Standard Detail and Specifications for Compost Logs (DE-ES-3.1.7).
4. Geotextile: Type GD-II for stone/riprap option.
5. Stone: DE No. 3 for stone/riprap option.
6. Riprap: R-6 for stone/riprap option.

Source:

Adapted from  
VA ESC Handbook  
& Filtrexx™ International

Symbol:



Detail No.

**DE-ESC-3.1.6**

Sheet 2 of 2

Effective FEB 2019